


# Condmaster® Nova - WEB and e-mail alarms

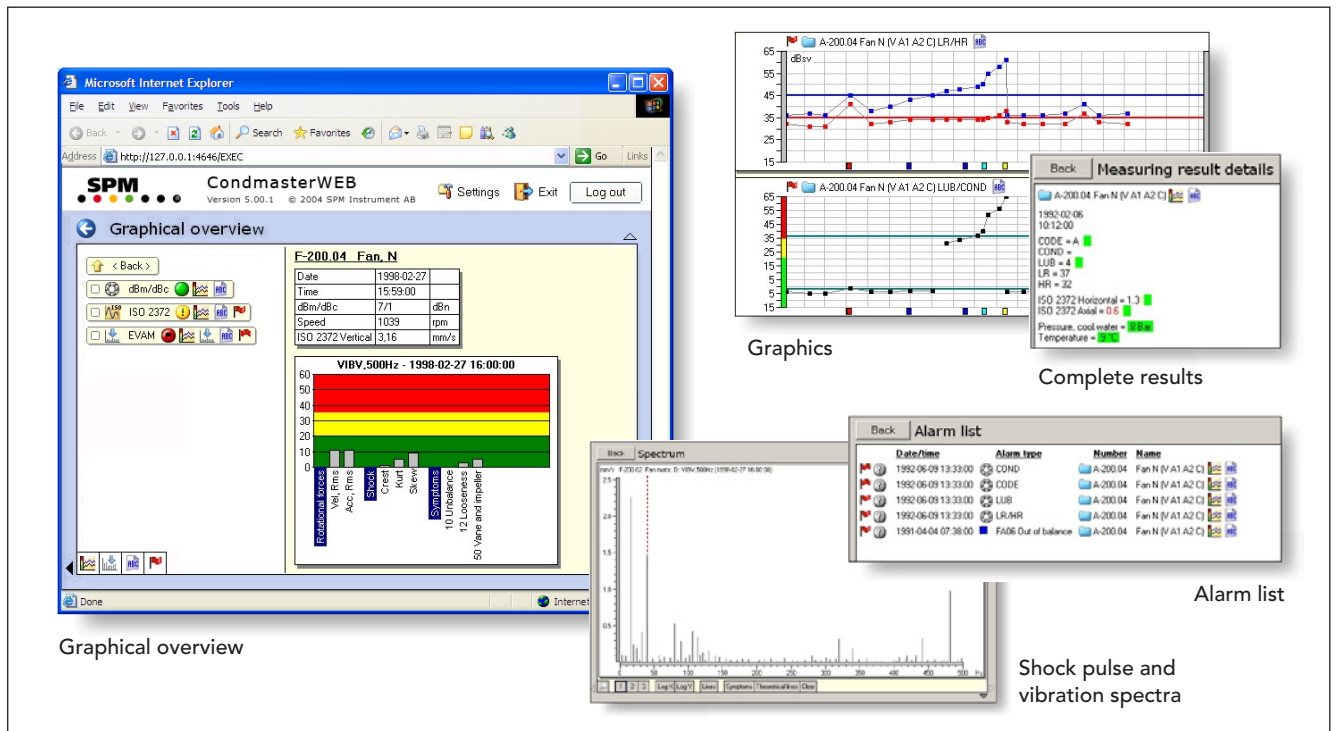

CondmasterWEB and e-mail alarms (MOD183) is an optional module in SPM's comprehensive maintenance program Condmaster®Nova.

With CondmasterWEB, users can reach their Condmaster program as a 'read only' version from any PC running Microsoft Internet Explorer 6 or higher. Thus, one can easily give access to Condmaster data by simply sending the name of the server on which CondmasterWEB is running to the party concerned.

CondmasterWEB will open in the Graphical Overview. By clicking on folders and icons, the user can quickly and easily get condition information in real time. Measuring results, alarm lists, graphics and spectra with zoom abilities are displayed in the same way as in the corresponding window of the 'real' Condmaster. Measuring point setups can be seen but not edited.

CondmasterWEB installs as a service on the server computer, which can be any PC with Windows NT or higher. A Web address is needed.

CondmasterWEB can be accessed from any PC via LAN or via Internet, normally through port 5790 (default).

Here are examples of addressing CondmasterWEB after logging on to the web with Microsoft Explorer.

A. CondmasterWEB is running on an external computer (= server) anywhere in the world or in the local network: [http://\(servername\):5790/](http://(servername):5790/)

B. CondmasterWEB is running on your own computer: <http://localhost:5790/>

E-mail Alarm sends selected alarms on selected components/measuring points via e-mail to stated addresses, according to a user defined weekly schedule. The e-mails can be rerouted to cellphones with SMS capability via messaging services.

As a general setup, the name of the company's mail server is input under 'Settings'. Each alarm mail assignment has a name and one or more recipients (e-mail addresses).

Measuring points and alarm types are selected from lists. In a week calendar, the user marks from - to periods. Alarms occurring during the marked periods will be sent by e-mail to all stated addresses. Users can also mark vacation periods on a year calendar, during which the mail service is suspended.

Alarm via cellphone requires the services of a company that redirects e-mail to cellphones. The user must make his own arrangement with the company providing the service.

Option modules and installation instructions are included on the Condmaster®Nova disc.

## Ordering number

MOD183 CondmasterWEB and e-mail alarms

